

Focus on Heating Ventilation and Air Conditioning

microflow component can be used in a by-pass flow channel as a differential pressure and sensor is soon available in combination with different USB plug and play evaluation boards.

MIDAS L13P348_E2 Chip #14 Flowlinien Ibr = 4mA Stromquelle MS1

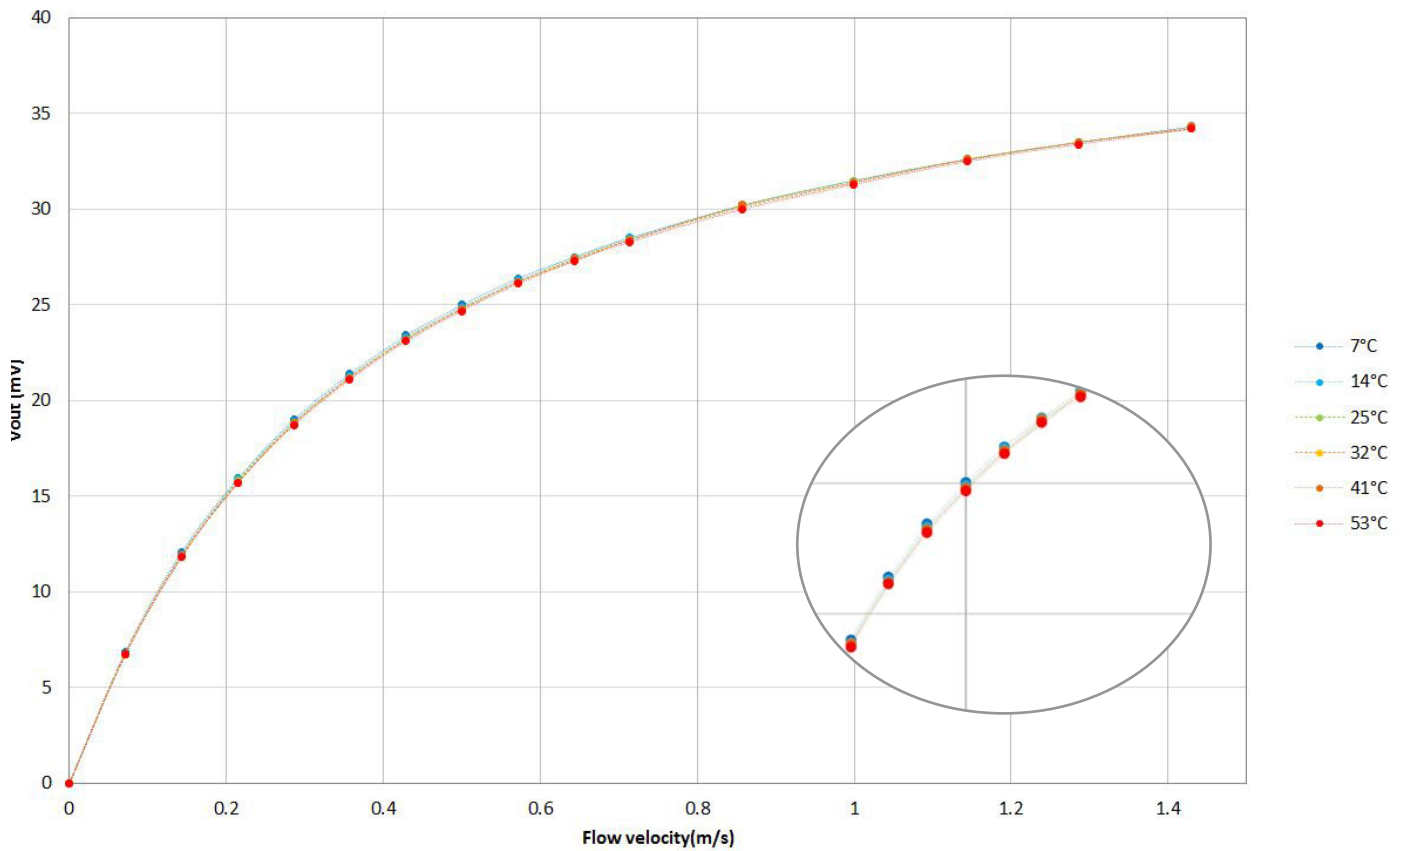


Diagram showing intrinsic temperature compensation



INNOVATIVE SENSOR TECHNOLOGY